




TELEPHONE: (902)542-7478
FAX: (902)542-7479
e-mail: info@britcycle.com
website: www.britcycle.com

604 DAVISON STREET, RR3 WOLFVILLE, NOVA SCOTIA, B4P 2R3, CANADA
146 PORTER STREET, HACKENSACK, NEW JERSEY, 07601, USA

INSTALLATION INSTRUCTIONS 331-105 MITY MAX 3 PHASE

(Negative Ground Shown)

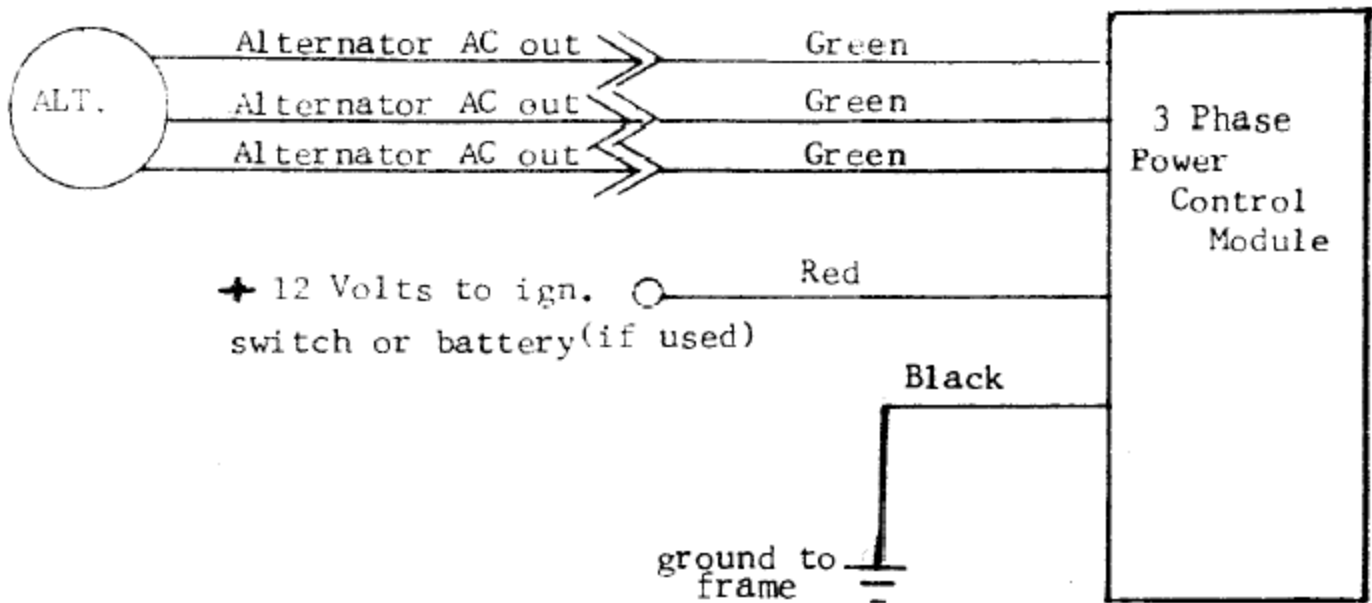

The output of the Power Control Module is 12 volts for Triumph, BSA and Norton, etc. Polarity is determined by which wire is grounded. (Black for negative ground; red for positive ground) The output of the PCM should be connected to the battery or ignition switch. The PCM case is electrically isolated from the circuitry and does not require grounding. The case must be tightly mounted to some part of the motorcycle that does not vibrate more than the frame and the case must not be allowed to rub or vibrate against any other component. Tighten the mounting bolts down until there is no free movement. Do not attempt to shock mount the PCM. The guarantee covers defects in workmanship or materials only; defaced or abused PCM's will not be repaired or replaced without cost. The date stamped on the PCM is the month and year of warranty expiration. (55 would be the end of the 5th month of 2005) Units are warranted for two years from the date of manufacture.

IMPORTERS AND DISTRIBUTORS OF PARTS AND ACCESSORIES
FOR CLASSIC TRIUMPH, BSA AND NORTON MOTORCYCLES
HELPING TO KEEP BRITISH MOTORCYCLES ON THE ROAD SINCE 1977!